








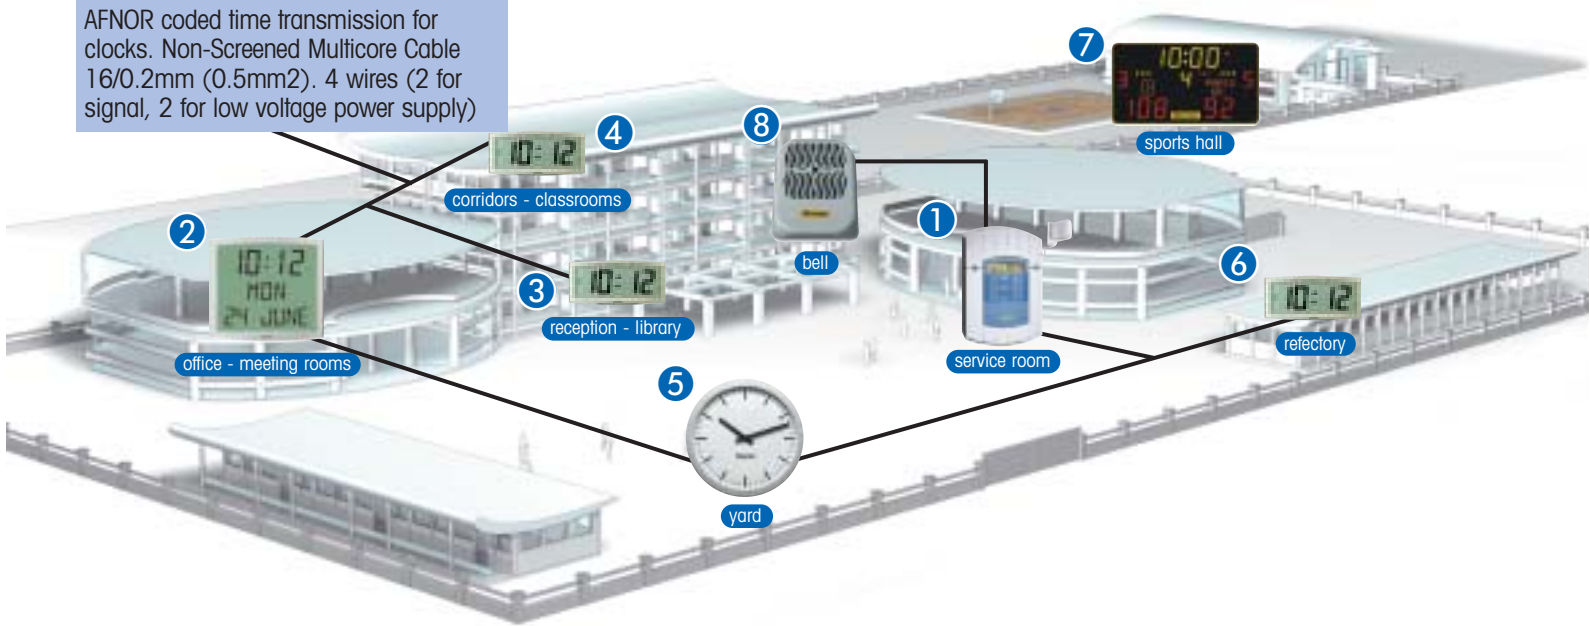

# School - University

AFNOR coded time transmission for clocks. Non-Screened Multicore Cable 16/0.2mm (0.5mm<sup>2</sup>). 4 wires (2 for signal, 2 for low voltage power supply)



Place	Description	Recommendation	Alternatives
1 service room	Master clock with programming circuits, radio synchronised, AFNOR coded time output signal 230V power supply	 Microquartz Della	MIC Alfa MIC S MTS IP time server
2 offices meeting rooms	LCD calendar clock Battery or very low voltage (TBT) power supply	 Cristalys Date	Style 7 Date Style 5 Date Cristalys Ellipse
3 reception library	LCD clock Hour - minute Battery or very low voltage (TBT) power supply	 Cristalys 7	Profil 940 I Style 7 Profil 930 I Cristalys 14
4 corridors classrooms	LCD clock Hour - minute Battery or very low voltage (TBT) power supply	 Cristalys 7	Style 5 Style 7 Profil 930 I
5 yard	Analogue clock Weatherproof, hour - minute 40cm Diameter Battery or very low voltage (TBT) power supply	 Profil 940 E	Profil 960 E Style 12
6 refectory	LCD clock Hour - minute, Battery or very low voltage (TBT) power supply	 Cristalys 7	Style 7 Profil 930 I
7 sport hall	Scoreboard Multi-sports Wireless keyboard 230V power supply	 BT6030	BT 6025 BT 6020
8 bell	Sound amplified unit 3 melodies / Bell ringing system for start & end of class 230V or 24V power supply delivered by the master clock	 CA 15	Outdoor CA 15