


Hospital - Clinic



AFNOR coded time transmission for clocks. Non-Screened Multicore Cable 16/0. 2mm (0.5mm²). 4 wires (2 for signal, 2 for low voltage power supply)

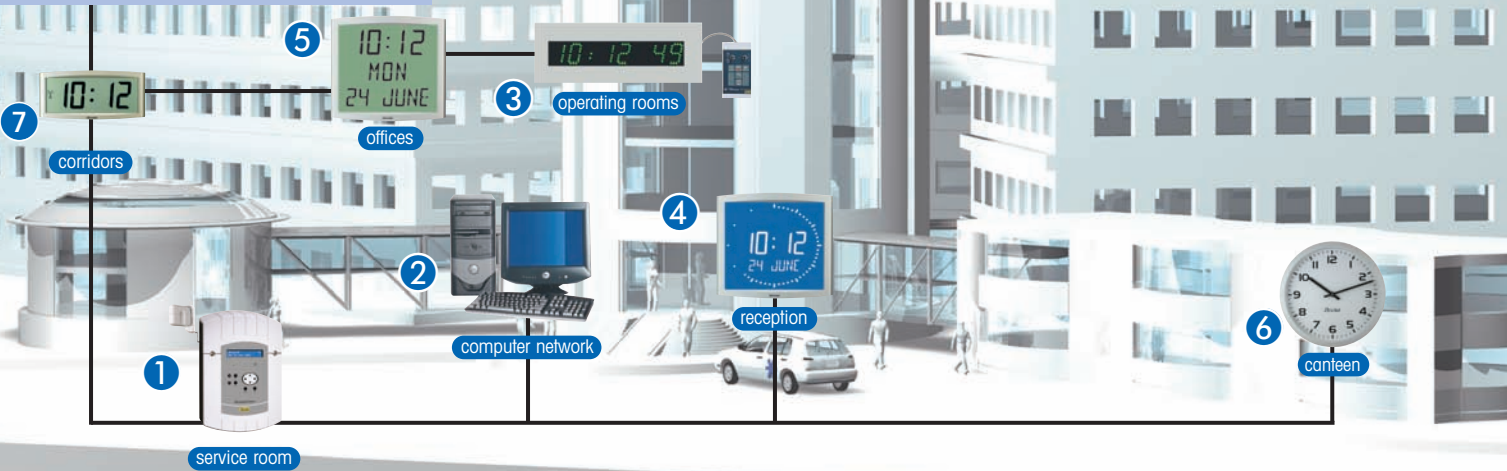

Place	Description	Recommendation	Alternatives
1 service room	Master clock, radio synchronised, coded time output signal 230V power supply Output: IP/ RS232/422		Mic Sigma P Centrale horaire MTS
2 computer network	Modular master clock Wireless time distribution, NTP time server for LAN or WAN computer network 230V power supply	 A	CTC - MTS
3 operating rooms	LED digital clock Hour, minute, second Stainless case, weatherproof front plane, recess frame delivered with a timer keyboard 230V power supply	 A	
4 receptions	Backlighted LCD clock Hour, minute, date, second 230V power supply	 A	Cristalys 14 Cristalys Date Profil 940 I Style 7 E
5 offices	LCD calendar clock Battery or very low voltage (TBT) power supply	 B or C	Cristalys 7 Style 5 Date Style 7
6 canteen	Analogue clock Hour, minute, 40cm diameter Very low voltage (TBT) power supply	 B	Cristalys 14 Style 7 Profil 930 I
7 corridors	LCD clock. Hour, minute Battery or very low voltage (TBT) power supply	 B	Profil 930 Style 7 Style 5

Power supply: A 230V Mains power B 1,5V batteries C 6/24V Very low voltage (TBT)

