











# Hospital - Clinic

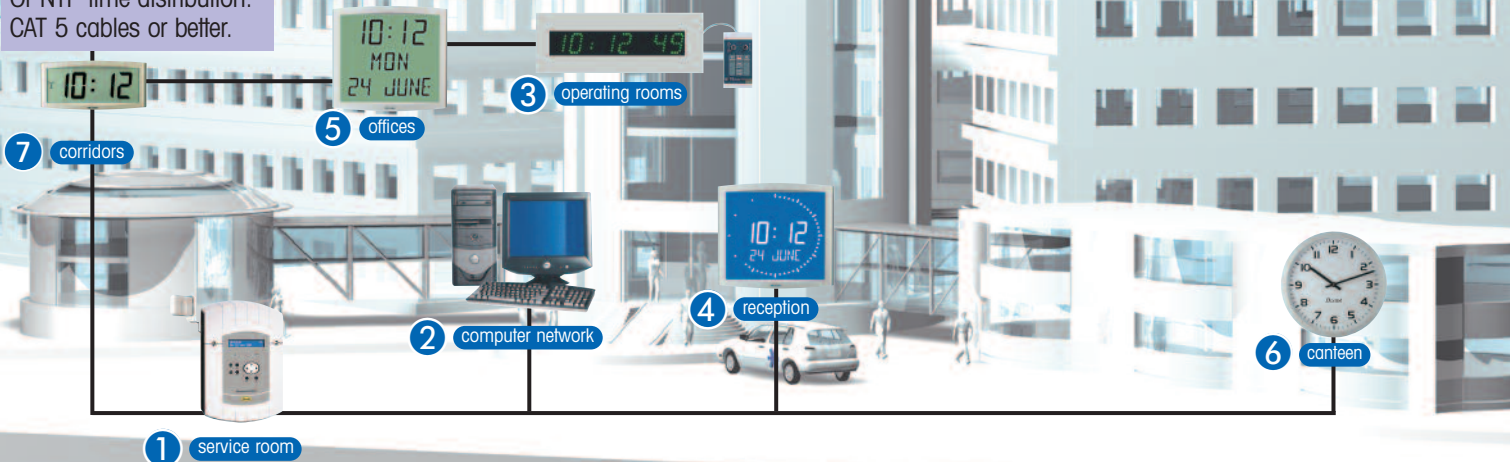

AFNOR coded time transmission for clocks. Non-Screened Multicore Cable 16/0. 2mm (0.5mm<sup>2</sup>). 4 wires (2 for signal, 2 for low voltage power supply)

Or NTP time distribution. CAT 5 cables or better.



Place	Description	Recommendation	Alternatives
1 service room	Master clock, radio synchronised, Time coded output signal, output: IP, RS232/422. 230v power supply.	 or  Sigma Mod	Sigma P Sigma Time Center with dual master clock plus Sigma Switch  Sigma Mod for NTP distribution
2 computer network	Sigma Mod master clock Wireless time distribution, NTP time server for LAN or WAN computer network 230v power supply	 or  Sigma Mod	Sigma P Sigma Time Center with dual master clock plus Sigma Switch  Sigma Mod for NTP distribution
3 operating rooms	LED digital clock Hour, minute, second Stainless steel case, weather-proof front panel, recess frame delivered with a timer keyboard 230v power supply	 Style 5 S Operating rooms	
4 receptions	Backlit LCD clock Hour, minute, date, second 230v power supply	 Opalys Ellipse	Cristalys 14 Cristalys Date Profil 940 I Style 7 E
5 offices	LCD calendar clock Battery or very low voltage (TBT) power supply	 Cristalys Date	Cristalys 7 Style 5 Date Style 7
6 canteen	Analogue clock Hour, minute, 40cm diameter Very low voltage (TBT) power supply	 Profil 940 I	Cristalys 14 Style 7 Profil 930 I
7 corridors	LCD clock. Hour, minute Battery or very low voltage (TBT) power supply	 Cristalys 7	Profil 930 Style 7 Style 5